

AIR-CONDITIONING PIPING SYSTEM

Distributed by:



sales@nxsphil.com.ph

Smart Number: 0921-341-5414

Viber Number: 0921-341-5405

B14 L4 Unit 2 Varisha Building, Silcas Village Brgy. San Francisco, Binan, Laguna

Revised on May 05, 2023



NXS PLASTIC PIPING SYSTEM FOR DX AIR CONDITIONING



Introduction

NXS Plastic pipe is a new alternative applied to air conditioning systems. Plastic pipe offers air conditioning performance equivalent to copper pipe, but at a low cost. In addition, it reduces installation time with its compression connection system that easily adapts to the air conditioning equipment.

Compared to traditional copper pipe, multilayer pipe is an innovative system that combines the advantages of

both plastic and metal pipes, offering ease of fold, tensile strength and extraordinary insulation capacity.

The Plastic multilayer pipe consists of 5 layers, an inner layer of cross-linked polyethylene (PE-X), an adhesive layer, an intermediate layer of aluminum, an adhesive layer and an outer layer of cross-linked polyethylene (PE-X).



- Easy to install
- Durable
- Barrier to the permeation of oxygen and light
- Multi-layer technology prevents natural corrosion and condensation problems
- Lower price than copper
- Light in weight
- Smooth inner wall ensures low pressure loss
- Less joints, reducing risk of leakage

Application

Designed for mini split air conditioning (cooling only).
 Maximum Working Temperature: 60°C
 Maximum Working Pressure: 552 PSI (38 Par)

Applicable refrigerant



Bending performance

Bending Radius	
Size(mm)	Radius(mm)
H-0712	60
H-0912	60
H-1216	80
H-1620	100
H-2025	125
H-2632	160

Standards

Compliance with the following codes:
 2021, 2018, 2015, 2012, 2009 and 2006
 International Mechanical Code®(IMC)
 2021, 2018, 2015, 2012, 2009 and 2006
 International Residential Code®(IRC)
 2021, 2018, 2015, 2012, 2009 and 2006 Uniform Mechanical Code®(UMC)*

*Uniform Mechanical Code is a copyrighted publication of the International Association of Plumbing and Mechanical Officials.

Compliance with the following standards:
 ·ASTM F1281-2017(R2021), Standard Specification for Crosslinked Polyethylene/Aluminum/Crosslinked Polyethylene (PEX-AL-PEX) Pressure Pipe

·ICC-ES LC 1035-2015, Standard Specification for Cross-linked Polyethylene/Aluminum/Cross-linked Polyethylene (PEX-AL-PEX) Pipe and Fittings for Refrigeration Applications

Certificates





Compression Fitting

Advantages



Easy installation, no need for welding



Corrosion resistant



Removable and reusable



Safe and reliable



Long service life

Air conditioner		Copper pipe dimension		Valve joint	NXS Plastic Pipe AC system	
HP	BTU/h	Inch	mm	UNF thread	Pipe	Fittings
1/2, 3/4, & 1	4500~11000	1/4	6.35	7/16"-20UNF	H-0712	F1-S0912*7/16(20UNF) C
		3/8	9.52	5/8"-18UNF	H-0912	F1-S0912*5/8(18UNF) C
1/5 & 2	11000~20000	1/4	6.35	7/16"-20UNF	H-0712	F1-S0912*7/16(20UNF) C
		1/2	12.7	3/4"-16UNF	H-1216	F1-S1216*3/4(16UNF) C
2.5	20000~24000	1/4	6.35	7/16"-20UNF	H-0712	F1-S0912*7/16(20UNF) C
		5/8	15.88	7/8"-14UNF	H-1620	F1-S1620*7/8(14UNF) C
3-5	24000~36000	3/8	9.52	5/8"-18UNF	H-0912	F1-S0912*5/8(18UNF) C
		5/8	15.88	7/8"-14UNF	H-1620	F1-S1620*7/8(14UNF) C
6-8	36000~52000	3/8	9.52	5/8"-18UNF	H-0912	F1-S0912*5/8(18UNF) C
		3/4	19.05	1 1/16"-14UNF	H-1825 or H-2025	F1-S1825*1 1/16(14UNF) C or F1-S2025*1 1/16 (14UNF) C

Specification

Plastics Pipe (H Serie)



Spec.	Packing Spec. (m)	Color(out/in)
H-0712	50/100	Golden/Transparent or White/Transparent
H-0912	50/100	Golden/Transparent or White/Transparent
H-1216	50/100	Golden/Transparent or White/Transparent
H-1620	50/100	Golden/Transparent or White/Transparent
H-1825	50/100	Golden/Transparent or White/Transparent
H-2025	50/100	Golden/Transparent or White/Transparent
H-2632	50/100	Golden/Transparent or White/Transparent

Insulated Air Conditioning Pair Coil



Pair coil	Pipe spec.	Coil thickness(mm)	Packing Spec. (m)
1/4"+3/8"	H- 0712+0912	10	25/30
1/4"+1/2"	H- 0712+1216	10	25/30
1/4"+5/8"	H- 0712+1620	10	25/30
3/8"+5/8"	H- 0912+1620	10	25/30
1/4"+3/8"	H- 0712+0912	8	25/30
1/4"+1/2"	H- 0712+1216	8	25/30
1/4"+5/8"	H- 0712+1620	8	25/30
3/8"+5/8"	H- 0912+1620	8	25/30
3/8"+3/4"	H- 0912+1825/2025	8	25/30

Female straight coupling



Spec.	Pcs/Box	Pcs/Ctn.
F1-S0712x5/8(18UNF) C	42	336
F1-S0712x7/16(20UNF) C	56	448
F1-S0912*7/16(20UNF) C	56	448
F1-S0912*5/8(18UNF) C	42	336
F1-S1216*3/4(16UNF) C	30	240
F1-S1620x7/8(14UNF) C	25	200
F1-S1825x1 1/16(14UNF) C		128
F1-S2025x1 1/16(14UNF) C	20	160

Straight Coupling



Spec.	Pcs/Box	Pcs/Ctn.
F1-S0912x0912 C	42	336
F1-S1216x1216 C	24	192
F1-S1620x1620 C	20	160
F1-S1825x1825 C		135
F1-S2025x2025 C	14	112
F1-S2632x2632 C		96

Compression to Copper Pipe Adapter



Spec.	Pcs/Box	Pcs/Ctn.
F1-S0912x1/4CuF(B280) C	50	400
F1-S0912x3/8CuF(B280) C	40	320
F1-S1216x1/2CuF(B280) C	50	400
F1-S1620x5/8CuF(B280) C	20	160
F1-S2025x3/4CuF(B280) C	24	192

*For copper pipe in line with ASTM B280

Pipe cutter



Spec.	Pcs/Box	Pcs/Ctn.
GJ IV		40

Reamer



Spec.	Pcs/Box	Pcs/Ctn.
Reamer 0912	10	50

Plastic reamer



Spec.	Pcs/Box	Pcs/Ctn.
ZYD2-0912-1216-1620	10	200
ZYD2-1216-1620-2025	10	180
ZYD2-1620-2025-2632	10	100
ZYD2-0912-1216-1825	10	200

Internal bending spring




Spec.	Pcs/Box	Pcs/Ctn.
WH-1216	25	150
WH-1620	15	90
WH-1825	9	54
WH-2025	9	54
WH-2032	4	24

External bending spring



Spec.	Pcs/Box	Pcs/Ctn.
WH-1216 II	6	36
WH-1620 II	4	24
WH-2025 II	2	12
WH-2632 II	1	6


Installation

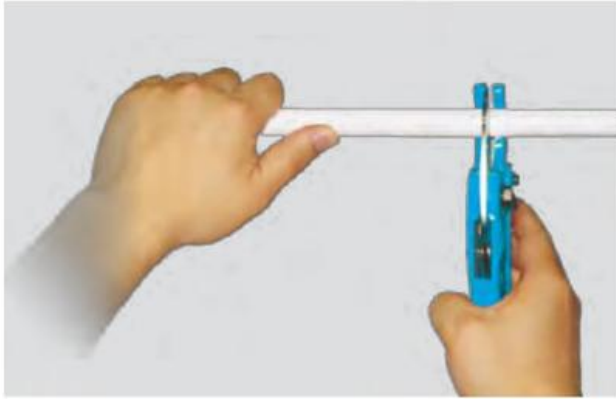


Step1:
Cut the pipe vertically and precisely with a pipe cutter.



Step2:
Round and bevel the ends with the RIIFO reamer

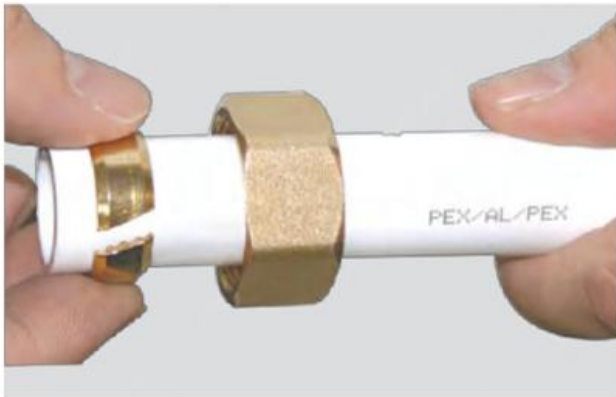


Step 3:
Choose the right size of the fitting according to the pipe; place the nut and then the compression ring onto the pipe.
Please note the threaded opening must face the end of the pipe.

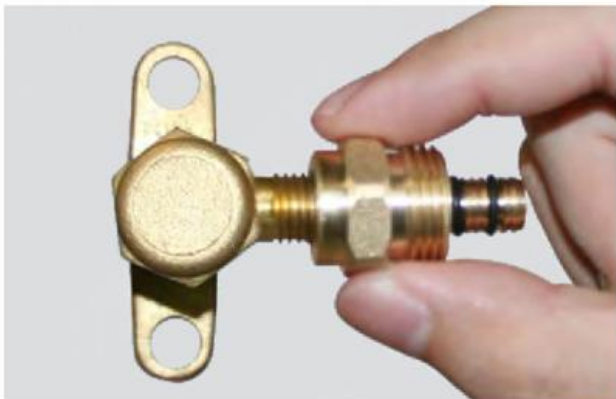

Step 4:
Install the fitting on the air conditioning valves.



Step 5
Tighten the fitting with a wrench

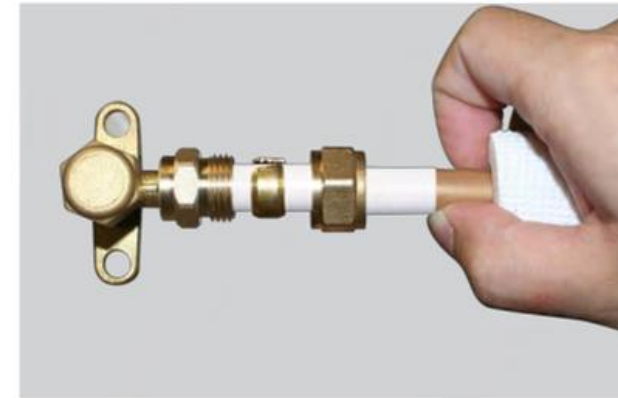

Step 6:
Push the inserts into the pipe up to the shoulder, take care not to damage the O-ring.



Step 7:
Tighten the nut with a wrench



Step 8:
Install insulation sleeve

AIR CONDITIONING PROTECTIVE PIPE SLOT

The NXS protective pipe system for air conditioning is designed with high-quality PVC raw materials that possess exceptional properties. These pipes are equipped with V0-class flame retardance, enabling them to self-extinguish in case of a fire outbreak, and can resist up to 2000V voltage fault, ensuring reliability and safety. Furthermore, they are resistant to acid and alkali as well as ultraviolet rays, providing effective protection to air conditioning pipes and extending their lifespan. The seamless modular splicing design facilitates easy installation, while the sealed connection prevents air convection, noise, and pests damage. Additionally, the white appearance of the pipes provides a clean and neat finish after installation.

In addition, our protective pipe slot offers significant cost and energy savings benefits. Damaged air conditioning pipes or insulation can lead to higher maintenance costs or even equipment replacement, which can be avoided with our protective pipe slot. By protecting the pipes' insulation, our product also helps to increase the efficiency of the system and reduce energy consumption, resulting in energy savings.

Advantages

- No pungent smell
- Acid and alkali resistance
- Self-extinguishing from fire
- Resistant to ultraviolet
- Long service life
- Reduce maintenance costs
- Energy Saving
- Sealed connections isolate air convection, and eliminate noise and pests



Performance parameter			
Characteristic	Testing method	Unit	Value/range
Vicat softening point (method 860)	ISO 306	°C	80
Thermal conductivity (20℃)	ISO 8302	W/mk	~0.17
Material grade	DINEN 13501-1		E
Linear expansion coefficient	ISO 11359	K-1	0.8*10-4
Specific heat capacity	ISO 11357	KJ/kgK	~1.05
Material performance description,measured at 23℃			
Characteristic	Testing method	Unit	Value/range
Density	ISO 1183	g/cm³	1.80±0.02
Tensile strength	ISO 527	N/mm²	≥15
Elongation at break	ISO 527	%	≥15
Bending strength	ISO 527	N/mm²	≥5
Impact strength 0℃	ISO 179 ⁻¹ 1eU	KJ/m²	Not broken
Impact strength 20℃	ISO 179 ⁻¹ 1eU	KJ/m²	Not broken
Notched impact strength	ISO 179 ⁻¹ 1eA	KJ/m²	≥1
Elastic Modulus	ISO 178	N/mm²	> 200
Shore D hardness	DIN 53606		81±3

System Component



Protective pipe
Used for effectively fixing and protecting air conditioning pipe




Straight coupling
Used for extension and connection of protection pipeline in order to meet the installation requirements of any length.



Elbow 90°
Apply to the pipe connection of vertical wall corner (available for both inner and outer corners)
It can be rotated horizontally and vertically 90° to change the pipeline direction.




Flat Elbow 90°
Applicable for connecting and redirecting pipes on flat walls. 90 degrees Horizontal and vertical rotation can change the direction of the pipe, but does not change the installation plane of the pipe.

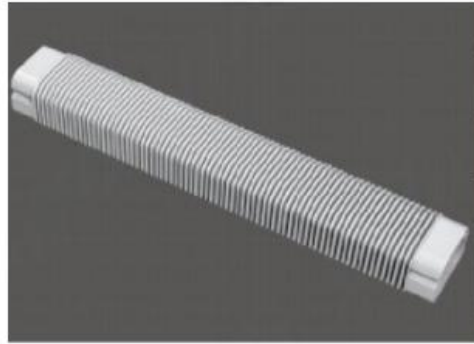

Flexible coupling

Apply to the air conditioning protection pipe slot to cross obstacles and get connecting in multiangle, and any radian. Scalable, suitable for any scene and convenient for construction.

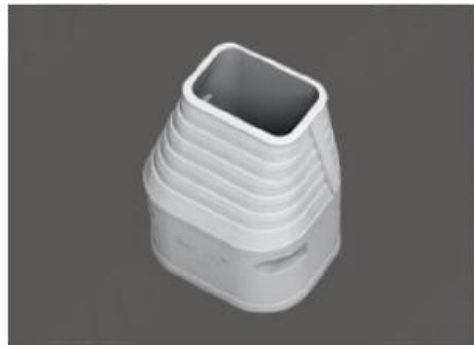

Reducer End Cap

Applicable for end connection between air conditioner and protective pipe.



Wall Entry Cap 90°


Installation and connection of 90 degrees angle between air conditioning holes and outer wall. Seamless modular splicing makes fast installation, and isolates noise caused by air convection, and pests.



Wall Entry Cap

Installation and connection of air conditioning holes inside and outside the wall. Seamless modular splicing makes fast installation, and isolates noise caused by air convection, and pests.


Installation

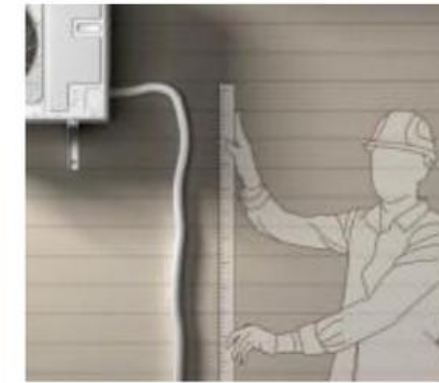


Use a measuring tool to measure the length of the air conditioning pipe.



Determine the distance and position of connection points, and mark the installation position of pipes and fittings.

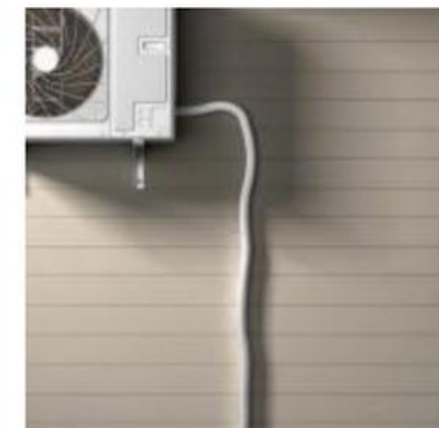

Check whether the pipeline is in line with the previous marked position. If it is in line, start the installation; and if not, re-determined the installation position.

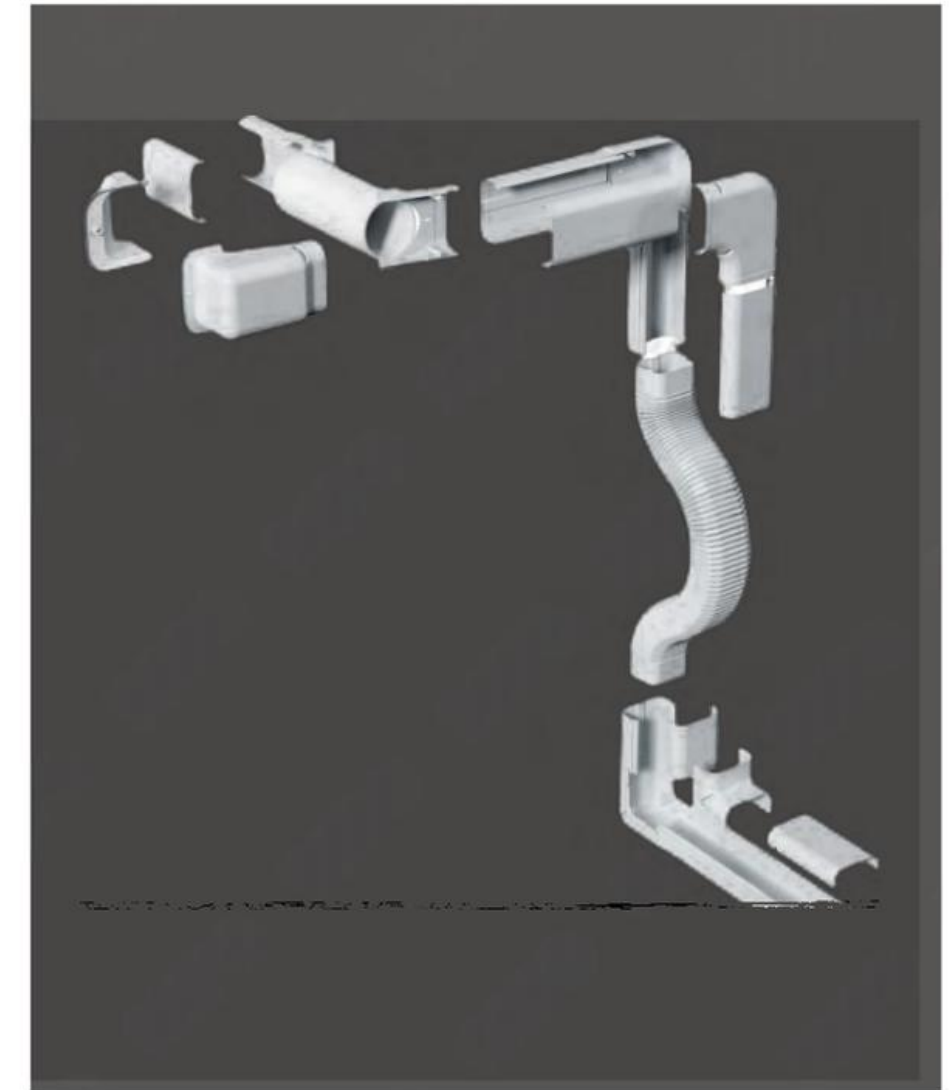


Install and place the air conditioning pipe into the protective pipe system and fix the air conditioning pipe



After installation, use the cover to protect the pipe



Fix the protective pipe. Check whether the buried electric wire is in the same position to avoid damage during drilling.

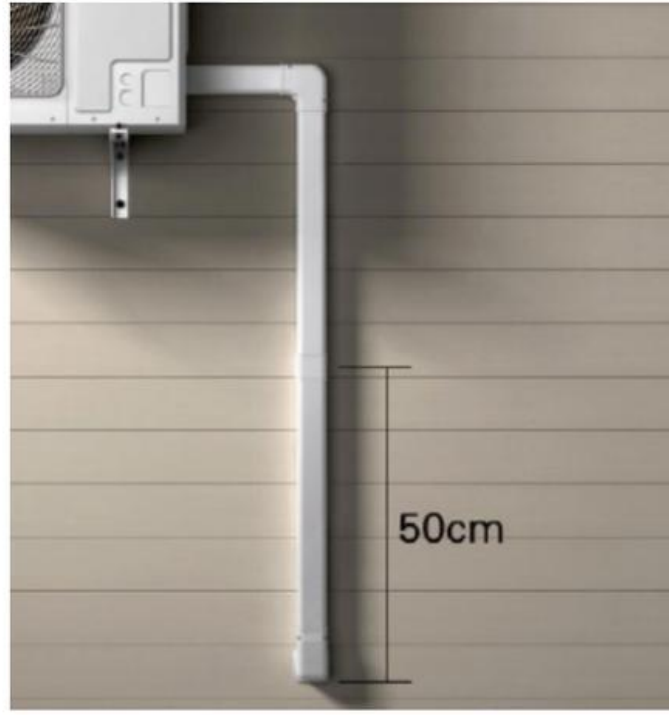

The distance between the starting point and the end point should not exceed 50cm, so as to prevent the protective pipe from warping and deformation, affecting the overall appearance.



When the installation of the protective pipe encounters obstacles or the situation where pipe cannot be installed properly, flexible coupling shall be used for connection.



During the installation of air conditioner, carefully bend the pipe so as to avoid fracture, which may lead to the difficulty of sealing the cover plate.

BEFORE & AFTER INSTALLATION OF PROTECTIVE PIPE

BEFORE



AFTER



BEFORE



AFTER

